



水務署
Water Supplies Department

香港灣仔告士打道七號入境事務大樓
Immigration Tower, 7 Gloucester Road, Hong Kong.

電子郵件
e-mail wsdinfo@wsd.gov.hk

電話 2829 4367
Telephone

圖文傳真 2824 0578
Facsimile

檔號 (6) in WSD 3321/11 Pt.1 T/J(234)
Reference

11 November 2011

Gate Way Valve & Fitting Ltd.
Flat A2, 4/F., Galaxy Factory Building,
25-27 Luk Hop Street, San Po Kong,
Kowloon, Hong Kong

(Attn.: Mr. Thomas C.H. KWONG)

Dear Sirs,

Approval of "Toyo" Cast Iron Gate Valves and Globe Valves

Your letters ref. GWL/11/00571 and GWL/11/00572 dated 19 October 2011 and 3 November 2011 respectively refer.

Having considered the test reports by the Castco Testing Centre Ltd., this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Toyo Valve Co., Ltd.

Country of Origin: Japan

Brand: Toyo

Details of Fittings: (1) 50mm, 65mm, 80mm, 100mm, 125mm, 150mm, 200mm, 250mm and 300mm Cast iron gate valves (no internally applied metallic coating) to BSEN1171; rising or non-rising stem; stainless steel stem; flanges drilled to BSEN1092-2; pressure rating PN16 for 16 bar working pressure maximum.

Model Nos. : Fig. No. 500S (rising stem);

Fig. No. 501S (non-rising stem)

Body Markings : 2010



PN16
DNXX

CI
→
(where XX denotes 50, 65, 80, 100, 125, 150, 200, 250 or 300)

- (2) 50mm, 65mm, 80mm, 100mm, 125mm, 150mm, 200mm, 250mm and 300mm Cast iron globe valves (no internally applied metallic coating) to BSEN13789; stainless steel stem; flanges drilled to BSEN1092-2; pressure rating PN16 for 16 bar working pressure maximum.

Model No. : Fig. No. 510S

Body Markings : 2010



PN16

DNXX

CI
→

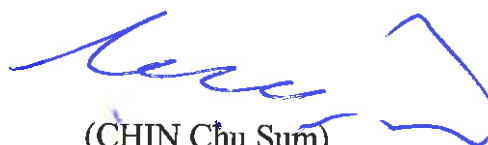
(where XX denotes 50, 65, 80, 100, 125, 150, 200, 250 or 300)

This Authority hereby permits the use of the above fittings in fresh water plumbing systems subject to full adherence to Waterworks installation requirements.

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in fresh water plumbing systems.

For the use of the fittings in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Yours faithfully,


(CHIN Chu Sum)
for Water Authority